


NOTA: "Se debe instalar de acuerdo a las indicaciones del capítulo 2.12 del Manual de Montaje de Ascensor Completo."
 NOTE: "It must be installed according to the indications of Complete Lift Assembly Manual 2.12 chapter."



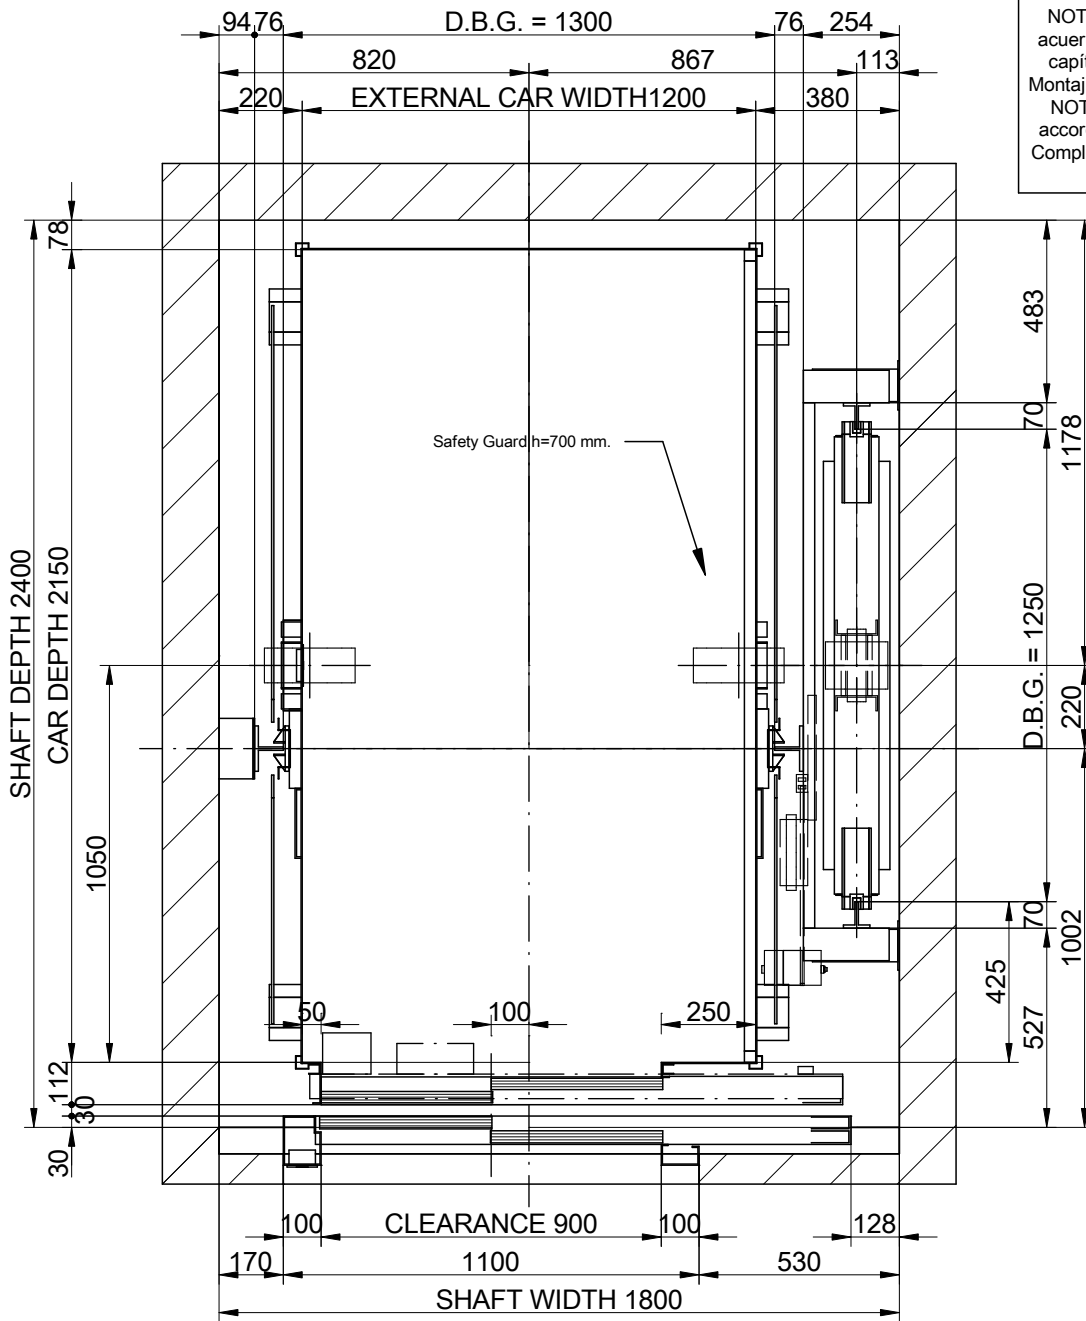


PLAN VIEW

SCALE(1): 1:20


The plan shows the recommended shaft dimensions.
 For minimum dimensions, the shaft width can be reduced by 100mm
 Shaft dimensions for a maximum P+Q of 2230kg.
 Please consult for larger P+Q's.

F-1-602.rev.3

(1)Unbounded dimensions in drawings are indicative and not binding.

STOPS (N°) 6		REV. 0		
CAPACITY (N° PERSONS) 15		REFERENCE:		
NOMINAL LOAD (Kg.) 1125		.		
DATE	NAME	CLIENT:	TENSION (V.) TRIFASICO.380V FREQUENCY (Hz.) 50	
DRAWING	MP	WORK SITUATION:		
VERIFIED				
APPROV.				
		MODEL LIFT	SPEED (m/s)	
		MP1510GO!	1	


SIDE VERTICAL SECTION

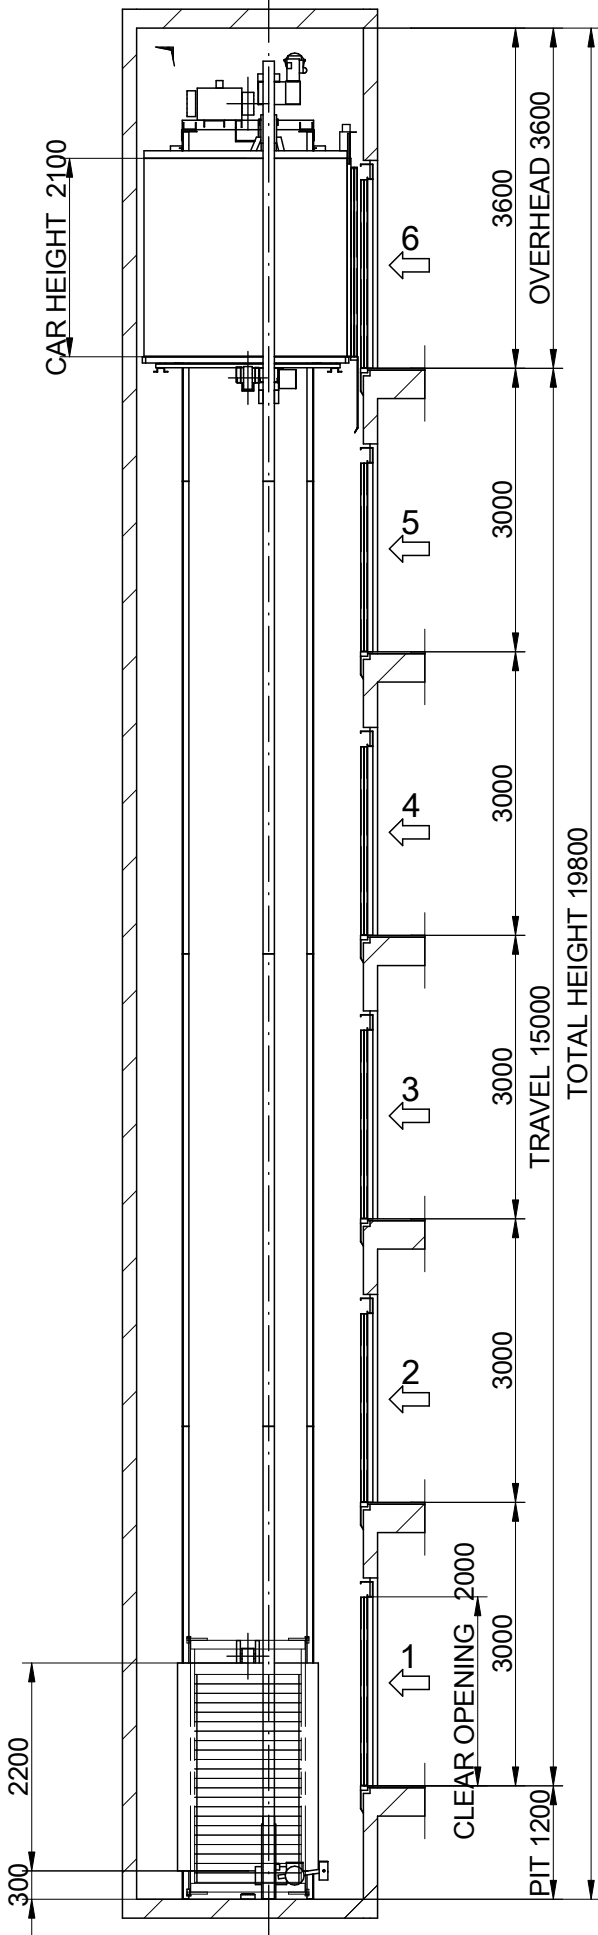

SCALE(1): 1:80


F-1-602.rev.3

(1)Unbounded dimensions in drawings are indicative and not binding.

		REV. 0	
		REFERENCE:	
STOPS (N°)	6	CLIENT:	
CAPACITY (N° PERSONS)	15	WORK SITUATION:	
NOMINAL LOAD (Kg.)	1125	TENSION (V.)	TRIFASICO.380V
DATE	2012	FREQUENCY (Hz.)	50
DRAWING VERIFIED	MP	<p>MP</p>	
APPROV.			
<p>MODEL LIFT MP1510GO! SPEED (m/s) 1</p>			

- Flat and levelled floor, protected against water leaking. (EN81-1:98, 5.7.3.1)
- Foresee pit access device (EN81-1:98, 5.7.3.2)
- Stop device (EN81-1:98, 5.7.3.4)
- Power supply (EN81-1:98, 5.7.3.4)
- Light swicht commuted with the cabinet. (EN81-1:98, 5.7.3.4)
- Telephone jack (except Fonotec) (EN81-1:98, 5.10)

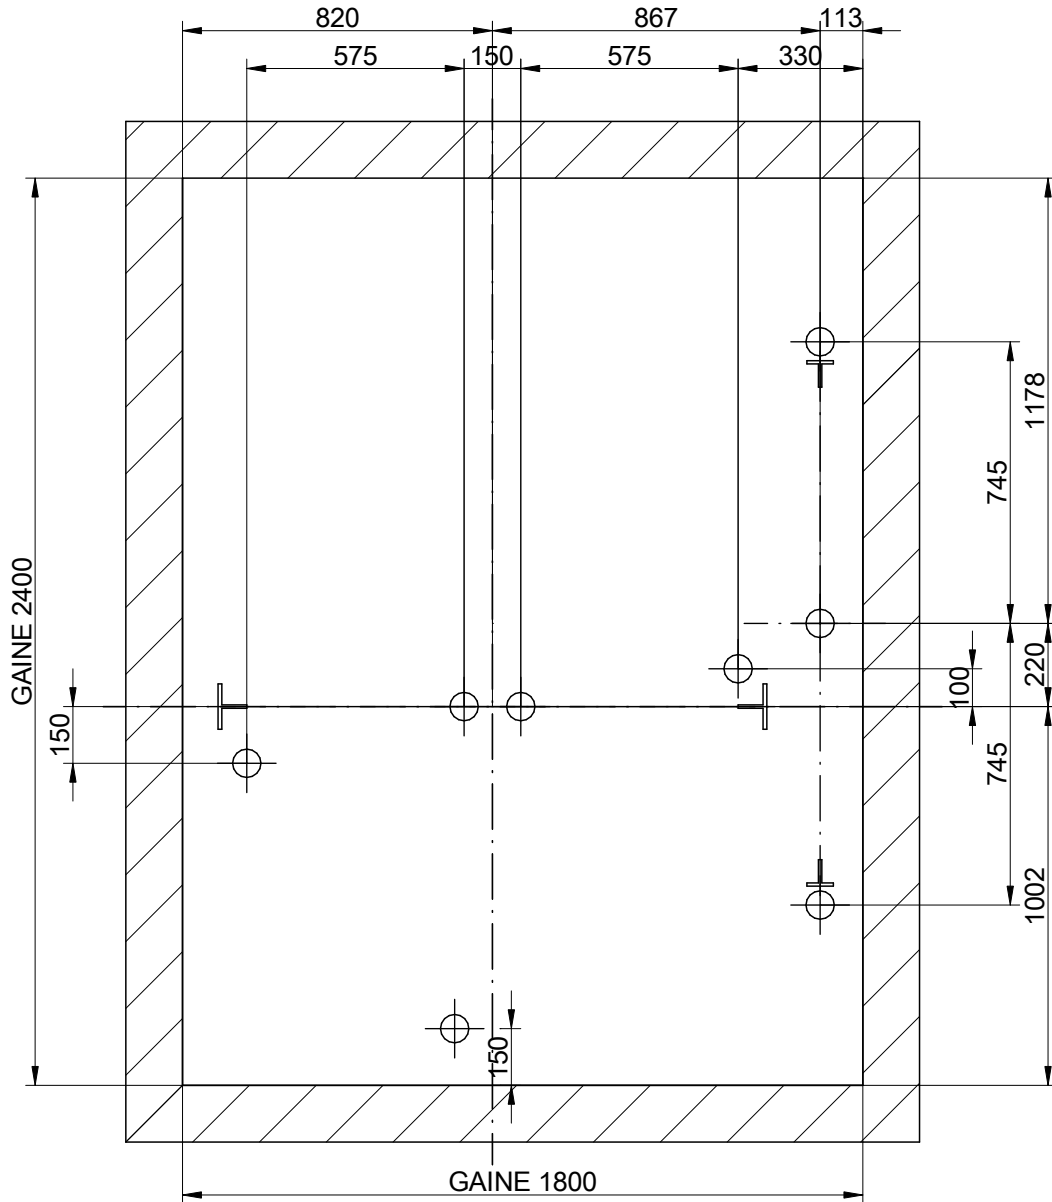

POSITION DES CROCHETS
 CAPABLES DE SUPPORTER
 2000 Kg. CHACUN.
 PAR LE CONSTRUCTAIR




POUTRE ET CROCHETS DU MONTAGE.
 ECHELLE⁽¹⁾: 1:20

F-1-602.rev.3

(¹)Les traits non cotés ne doivent pas servir pour des mesures.

NIVEAUX (n°)		6	REV. 0		
CAPACITE (Nbre DE PERS.)		15	REFERENCE:		
CHARGE NOMINALE (Kg.)		1125	:		
DESSINÉ	DATE	NOM	CLIENT:		TENSION RESEAU (V.) TRIFASICO.380V FREQUÉNCÉ (Hz.) 50
CONTROLÉ	2012	MP	SITUATION CHANTIER:		
APROUVÉ			:		
			ASCENSEUR MODELE		VITESSE (m/s)
			MP1510GO!		1

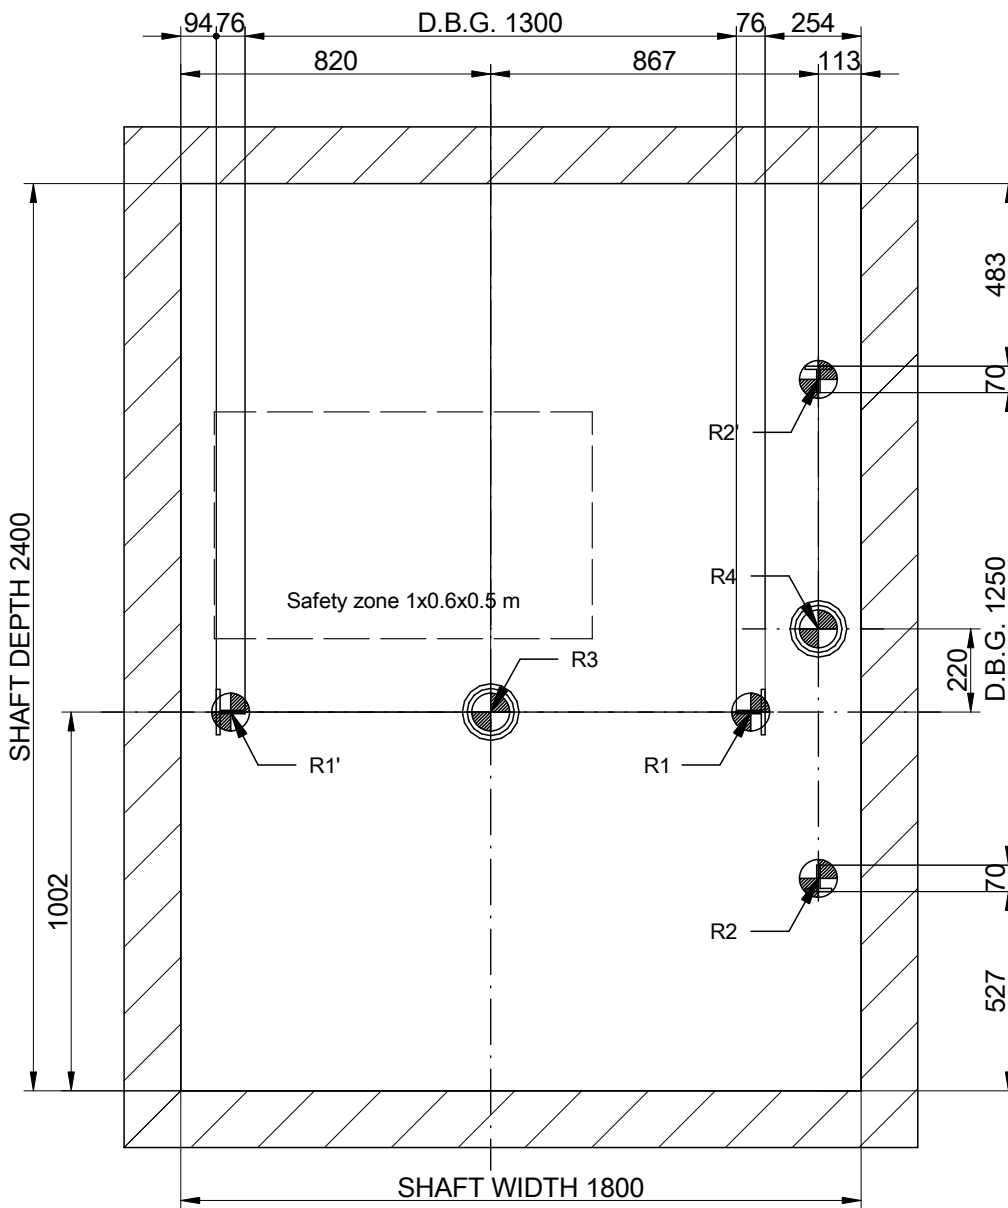



R1:31000 N
 R2:25000 N
 R2':25000 N
 R3:88000 N
 R4:66000 N
 N:2800 N
 T:1800 N



PIT LAYOUT

SCALE⁽¹⁾: 1:20

F-1-602.rev.3

(¹)Unbounded dimensions in drawings are indicative and not binding.

STOPS (N°) 6 CAPACITY (N° PERSONS) 15 NOMINAL LOAD (Kg.) 1125		REV. 0 REFERENCE: . .		
DATE 2012	NAME MP	CLIENT: WORK SITUATION: .		
APPROV.				
			MODEL LIFT MP1510GO!	SPEED (m/s) 1

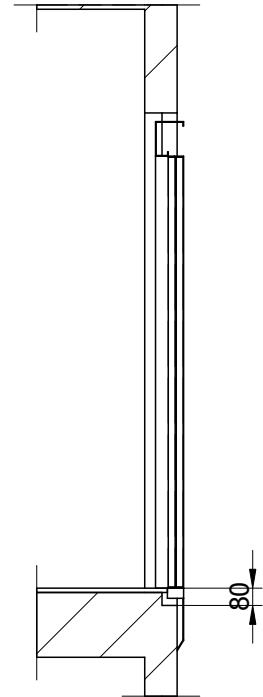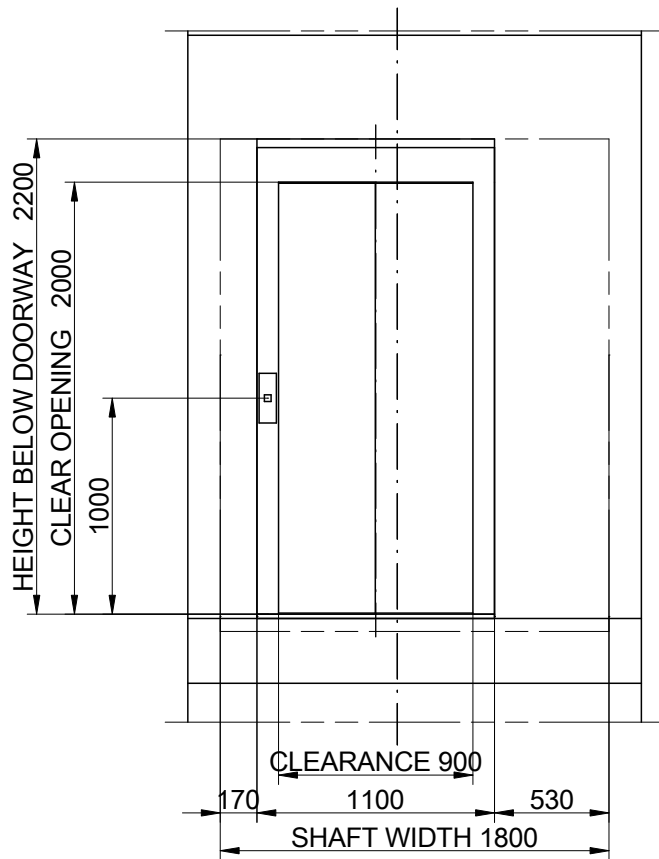



DOOR HOLE DETAIL

SCALE(1): 1:35

F-1-602.rev.3

(*)Unbounded dimensions in drawings are indicative and not binding.

STOPS (N°) 6		REV. 0		
CAPACITY (N° PERSONS) 15		REFERENCE:		
NOMINAL LOAD (Kg.) 1125		:		
DATE	NAME	CLIENT:	TENSION (V.)	TRIFASICO.380V FREQUENCY (Hz.) 50
2012	MP	WORK SITUATION:		
VERIFIED				
APPROV.				
		MODEL LIFT	SPEED (m/s)	
		MP1510GO!	1	

WORK BY THE CUSTOMER

SHAFT: The structure of the shaft must be built according to the national building rules. Wall of the shaft must resist a pressure of 300 N in 5 cm² area, according EN81-1:98 5.3.1.1. Nominal dimensions according to the drawings. Safety protections fitted. Floor levels signalled. The only use of the shaft must be for a lift installation. The recommended shaft ventilation is 1% of its transversal section (according to 5.2.3 EN81-1) The enclosure shall be impermeforate, unless otherwise indicated. (EN81-1/2:98+A3:2009, 5.2.1.1)

CABINET: easy access, properly ventilated, with own lighting (or landing lighting) with 200 lux at the floor level, temperature between 5 °C and 40 °C. Non slippery and not dust generator floor.

CABINET ACCESS: properly illuminated. The access must be easy to use in any case, without necessity to go into private locals. The minimum crossing areas required by the rules of buildings must not be blocked for the lift or cabinet open doors.

ROOF SHAFT: suspensions hooks in the roof, prepared to resist the loads.

ELECTRIC SUPPLY: including statutory wiring up to the cabinet, with neutral, earth and lighting cables.

ELECTRICAL WIRING according to manuals.

LANDING ILUMINATION: 50 lux at floor level.

EARTHING of all electric installation according to the statutory prescriptions in the harmonizing document CENELEC HD 384-5-54 S1.


PIT: flat and levelled pit floor, protected against water licking, able to resist loads according to drawings.

Permanent pit access device. When there are accessible areas placed under car or counterweight trajectory, the pit floor must be calculated for a 5000 N/m² minimum charge, and if the counterweight has not got a safety gear, a pillar that descend up to floor under counterweight buffer must be placed.

NOTE: The project carries out the application requisites of RD 1314/1997 (*). For eventual Rules of Local Buildings, Accessibility, Fire protection, ..., the client is responsible and he will have to control the fulfilment. The present drawing is developed by means of the facilitated information and it has caused the technical documents for the achievement of our products. Eventual MODIFICATIONS which affect their construction, will lead to the inspection of our order confirmation.



(*) For lifts in Spain "RD 1314/1997". 95/16/EC for lifts of the rest of Europe.

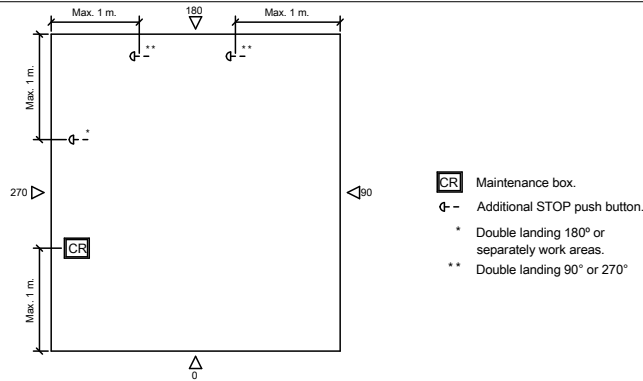CAR ROOF SKETCH



F-1-602.rev.1

DATE	NAME	MODIFICATIONS	REV.

STOPS (N°)	6	REV. 0		
CAPACITY (N° PERSONS)	15	REFERENCE:		
NOMINAL LOAD (Kg.)	1125	.		
DATE	2012	NAME	CLIENT:	TENSION (V.) TRIFASICO.380V FREQUENCY (Hz.) 50
DRAWING		MP	WORK SITUATION:	
VERIFIED				
APPROV.				
		MODEL LIFT	SPEED (m/s)	
		MP1510GO!	1	